

Features

- 2-channel isolated barrier
- 24 V DC supply (bus or loop powered)
- Output 40 mA at 11.2 V DC, 55 mA current limit
- Contact or logic control input
- Entity parameter $I_O/I_{SC} = 93$ mA
- Line fault detection (LFD)
- Up to SIL2 acc. to IEC 61508 (bus powered)
- Up to SIL3 acc. to IEC 61508 (loop powered)

Function

This isolated barrier is used for intrinsic safety applications. It supplies power to solenoids, LEDs, and audible alarms, located in a hazardous area.

It is controlled with a loop-powered control signal, switch contact, transistor, or logic signal.


At full load, 11.2 V at 40 mA (with 55 mA current limit) is available for the hazardous area application.

An alternative low current output is available for driving a single LED without installing an external current limiting resistor.


Line fault detection of the field circuit is indicated by a red LED and an output on the fault bus.

This device mounts on a HiD Termination Board.

Assembly

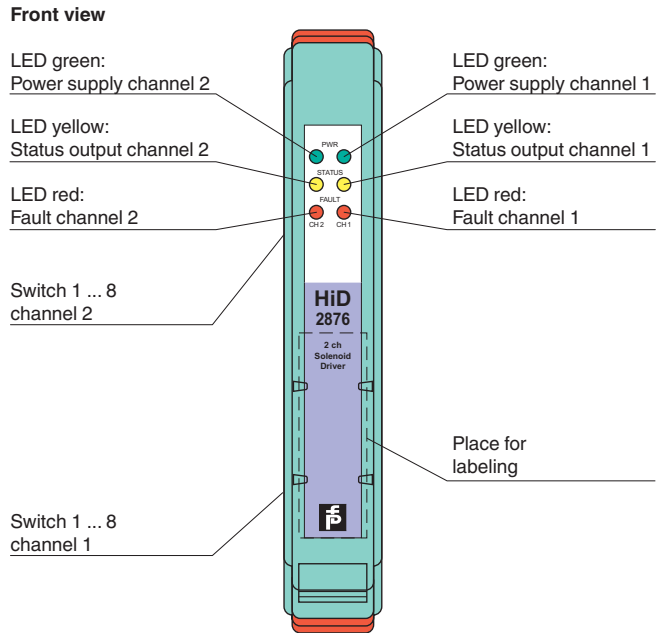


Connection

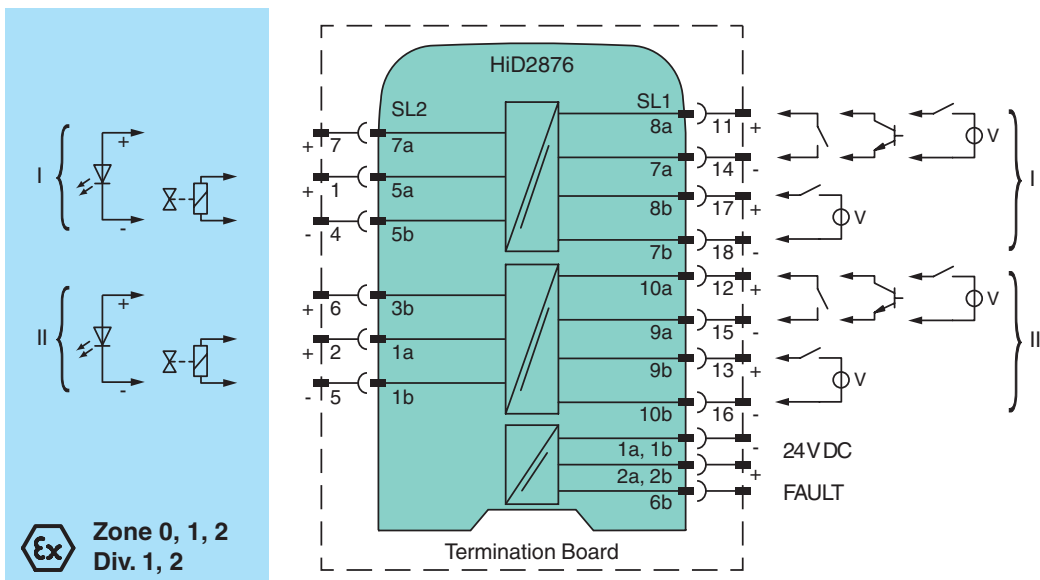

Release date 2014-06-06 14:40 Date of issue 2014-07-30 204847_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

General specifications		
Signal type		Digital Output
Supply		
Connection		SL1: 1a(-), 1b(-); 2a(+), 2b(+)
Rated voltage		20.4 ... 30 V via Termination Board or 20.4 ... 30 V via loop powered input , reverse polarity protected
Input current		62 mA at 24 V, 300 Ω load (per channel)
Power loss		1 W at 24 V, 300 Ω load (per channel)
Input		
Connection		SL1: 8a(+), 7a(-); 10a(+), 9a(-) bus powered SL1: 8b(+), 7b(-); 9b(+), 10b(-) loop powered
Control input		external switch (dry contact or open collector) non isolated or logic signal input fully floating
Signal level		1-signal: 15...30 V DC (current limited at 3 mA) or contact close (internal 10 kΩ pull-up) 0-signal: 0...5 V DC or contact open
Power loss		1 W at 24 V, 300 Ω load (per channel) for loop powered
Inrush current		0.2 A , 15 ms loop powered
Output		
Connection		SL2: 5a(+), 5b(-), 7a(+); 1a(+), 1b(-), 3b(+)
Internal resistor	R_i	approx. 280 Ω
Current	I_e	≥ 40 mA
Voltage	U_e	≥ 11.2 V
Current limit	I_{max}	55 mA
Open loop voltage	U_s	approx. 22.5 V
Load		nominal 0.1 ... 5 kΩ
Switching frequency	f	- bus powered: filter OFF: max. 150 Hz, filter ON: max. 15 Hz - loop powered: max. 10 Hz
Energized/De-energized delay		- bus powered: filter OFF: 1 ms, filter ON: 10 ms - loop powered: switch-on 50 ms, switch-off 6 ms (300 Ω load)
Error message output		
Connection		SL1: 6b
Output type		open collector transistor (internal fault bus)
Fault current		4 mA pulsing (20 ms ON, 200 ms OFF)
Fault level		lead short-circuit detection at < 25 Ω lead breakage detection at > 100 kΩ typical
Electrical isolation		
Output/Output		safe electrical isolation acc. to EN 60079-11: 2007, voltage peak value 60 V
Output/power supply, inputs, and collective error		safe electrical isolation acc. to EN 60079-11: 2007, voltage peak value 375 V
Directive conformity		
Electromagnetic compatibility		
Directive 2004/108/EC		EN 61326-1:2006
Conformity		
Electromagnetic compatibility		NE 21:2006 For further information see system description.
Degree of protection		IEC 60529:2001
Ambient conditions		
Ambient temperature		-20 ... 60 °C (-4 ... 140 °F)
Relative humidity		5 ... 90 %, non-condensing up to 35 °C (95 °F)
Mechanical specifications		
Degree of protection		IP20
Mass		approx. 140 g
Dimensions		18 x 106 x 128 mm (0.7 x 4.2 x 5 in)
Mounting		on Termination Board
Coding		pin 1 and 3 trimmed For further information see system description.
Data for application in connection with Ex-areas		
EC-Type Examination Certificate		CESI 10 ATEX 036 , for additional certificates see www.pepperl-fuchs.com
Group, category, type of protection		 II (1)GD [Ex ia] IIC, [Ex iaD] [circuit(s) in zone 0/1/2/20/21/22]
Output		Ex ia, Ex iaD
Voltage	U_o	26 V
Current	I_o	93 mA
Power	P_o	605 mW
Supply		
Maximum safe voltage	U_m	253 V AC (Attention! U_m is no rated voltage.)
Statement of conformity		PF 10 CERT 1729 X , observe statement of conformity

Release date 2014-06-06 14:40 Date of issue 2014-07-30 204847_eng.xml

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com


USA: +1 330 486 0002
pa-info@us.pepperl-fuchs.com

Germany: +49 621 776 2222
pa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
pa-info@sg.pepperl-fuchs.com

Group, category, type of protection, temperature class	Ex II 3G Ex nA II T4
Directive conformity	
Directive 94/9/EC	EN 60079-0, EN 60079-11, EN 60079-15, EN 60079-26, EN 61241-0, EN 61241-11
International approvals	
CSA approval	
Control drawing	366-005CS-12B (cCSAus)
IECEX approval	IECEX CES 10.0013
General information	
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com.

Configuration

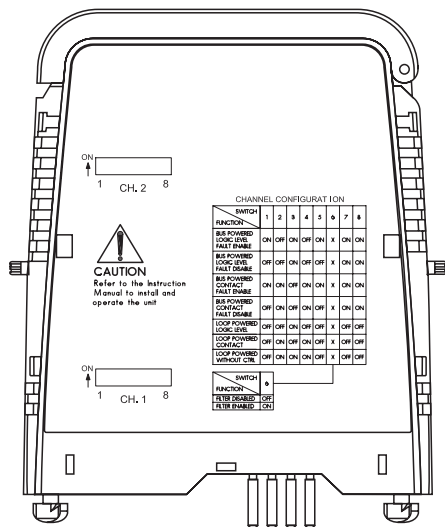


Switch settings

Switches for channel I and II	S1	S2	S3	S4	S5	S6	S7	S8
Function								
• Bus powered • Control input: logic signal • Line fault detection enable	ON	OFF	ON	OFF	ON	X	ON	ON
• Bus powered • Control input: logic signal • Line fault detection disable	OFF	OFF	ON	OFF	OFF	X	ON	ON
• Bus powered • Control input: contact • Line fault detection enable	ON	ON	OFF	ON	ON	X	ON	ON
• Bus powered • Control input: contact • Line fault detection disable	OFF	ON	OFF	ON	OFF	X	ON	ON
• Loop powered • Control input: logic signal	OFF	OFF	ON	OFF	OFF	X	OFF	OFF
• Loop powered • Control input: contact	OFF	ON	OFF	ON	OFF	X	OFF	OFF
• Loop powered • Control input: without control	OFF	ON	ON	ON	OFF	X	OFF	OFF

Switches for channel I and II	S6
Function	
Filter disable	OFF
Filter enable	ON

Factory settings: bus powered, control input: contact, line fault detection enabled, filter disabled

 To reduce the power consumption of the device, we recommend to set the DIP switches of channel II in the OFF condition, when channel II is not used (single channel application).

The new device HiD2876 will replace the devices HiD2875, HiD2876, HiD2877 and HiD2878. The new device HiD2876 has the same device functions as the four previous devices. If you want to use the specific device functions of the previous devices, you must configure the new device HiD2876. See following table.

Release date 2014-06-06 14:40 Date of issue 2014-07-30 204847_eng.xml

Previous device				New device									
HiD2875, part number 121486 HiD2876, part number 121489				HiD2876, part number 204847									
Settings	S1	S2	S3	Settings	S1	S2	S3	S4	S5	S6	S7	S8	
Bus powered with control	OFF	ON	ON	<ul style="list-style-type: none"> Bus powered Control input: contact Line fault detection disable 	OFF	OFF	ON	OFF	OFF	X	ON	ON	
Loop powered	ON	OFF	OFF	<ul style="list-style-type: none"> Loop powered Control input: without control 	OFF	ON	ON	ON	OFF	X	OFF	OFF	
Loop powered with control	OFF	OFF	OFF	<ul style="list-style-type: none"> Loop powered Control input: logic signal 	OFF	OFF	ON	OFF	OFF	X	OFF	OFF	
HiD2877, part number 121512 HiD2878, part number 121515				HiD2876, part number 204847									
Settings	S1	S2	S3	Settings	S1	S2	S3	S4	S5	S6	S7	S8	
Contact or open collector	ON	ON	OFF	<ul style="list-style-type: none"> Bus powered Control input: contact Line fault detection disable 	OFF	ON	OFF	ON	OFF	X	ON	ON	
Logic input	OFF	OFF	ON	<ul style="list-style-type: none"> Bus powered Control input: logic signal Line fault detection disable 	OFF	OFF	ON	OFF	OFF	X	ON	ON	

Configure the device in the following way:

- Push the red Quick Lok Bars on each side of the device in the upper position.
- Remove the device from Termination Board.
- Set the DIP switches according to the figure.




The pins for this device are trimmed to polarize it according to its safety parameter. Do not change! For further information see system description.



When both channels of the solenoid driver are operated in normally energised condition, either the load must be reduced or increased spacing/ventilation be applied to reduce the temperature rise. Contact Pepperl+Fuchs for guidance.

Output characteristics

Output circuit diagram



Output characteristic

